



**STANDARD LAYOUT FOR INDOOR WATER METER INSTALLATION
WITHOUT BACKFLOW PROTECTION**
(all piping must be copper)

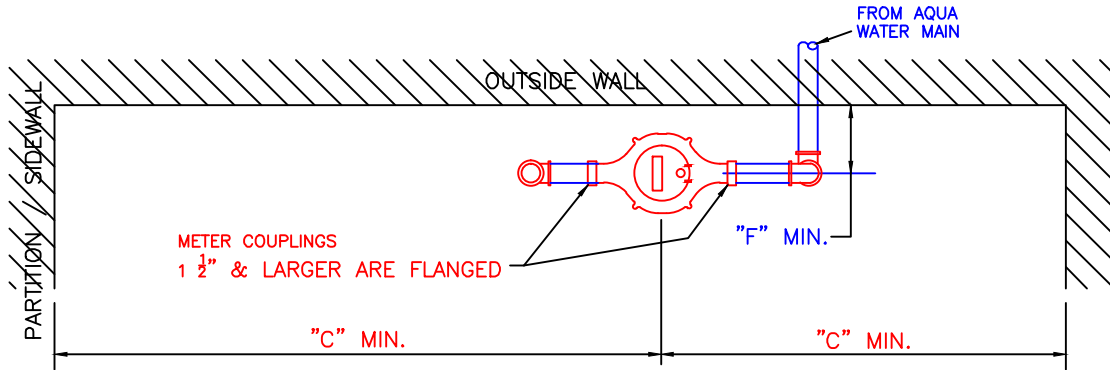

PLAN

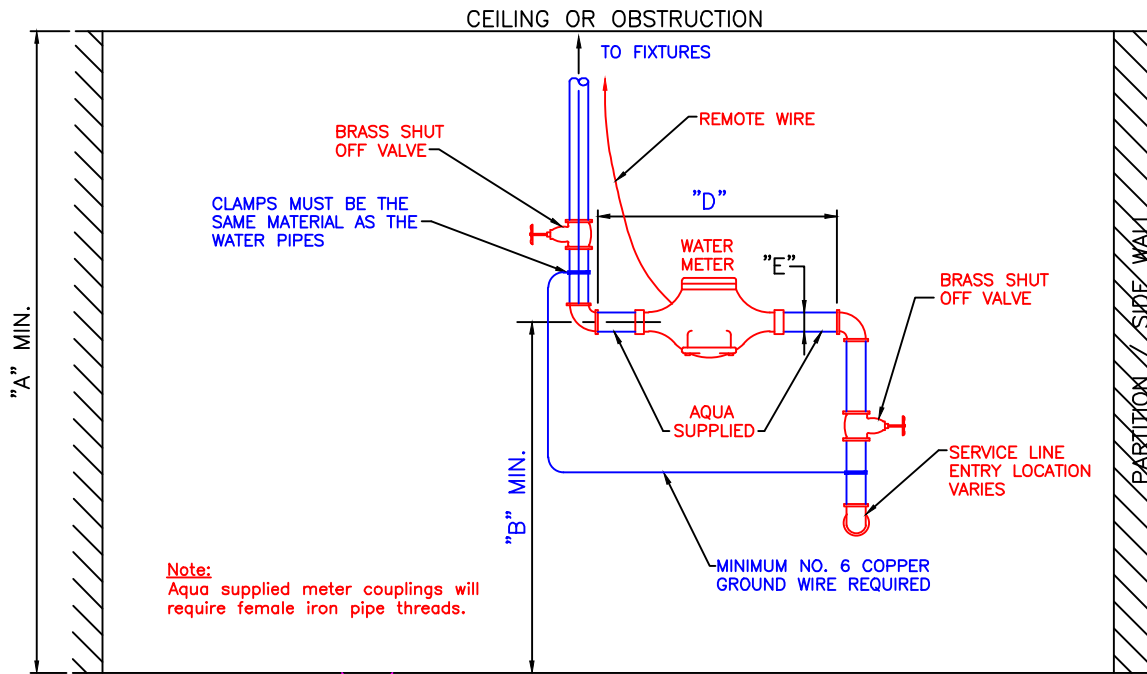

ELEVATION

Meter Size	"A" Min.	"B"		"C" Min.	"D"	"E" Pipe Thread	"F" Min.
		Min.	Max.				
5/8" X 3/4"	6'-0"	1'-6"	3'-0"	3'-0"	12 1/4"	3/4"	3"
3/4"	6'-0"	1'-6"	3'-0"	3'-0"	12 1/4"	3/4"	4"
1"	6'-0"	1'-6"	3'-0"	3'-0"	15 3/4"	1"	5"
1 1/2"	6'-0"	1'-6"	3'-0"	3'-0"	13"	Flanged	7"
2"	6'-0"	1'-6"	3'-0"	3'-0"	17 1/4"	Flanged	9"



AQUA OHIO, INC.

SERVICE CENTER, BOARDMAN, OH. 44512

AN AFFILIATE OF AQUA AMERICA, INC.

SUBJECT

**METER INSTALLATION
NO BACKFLOW PREVENTOR**
NOT TO SCALE

revised June, 2010

division CORPORATE STANDARDS

drawn D. Warrick

date Sept., 1998

approved R. Byrom, P.E.

sheet