


TYPICAL AQUA OHIO, INC. OUTSIDE METER VAULT WITH 5/8" x 3/4" AND 1" METERS (WITH BACKFLOW PREVENTER)

(all piping in vault must be copper)



- NOTES:**
- 24"(dia.) x 36" meter vaults may be constructed of corrugated plastic.
 - Contractor to remove and re-install meter at time of service renewal. Residents to be notified before shut off. (DO NOT CUT METER WIRE)

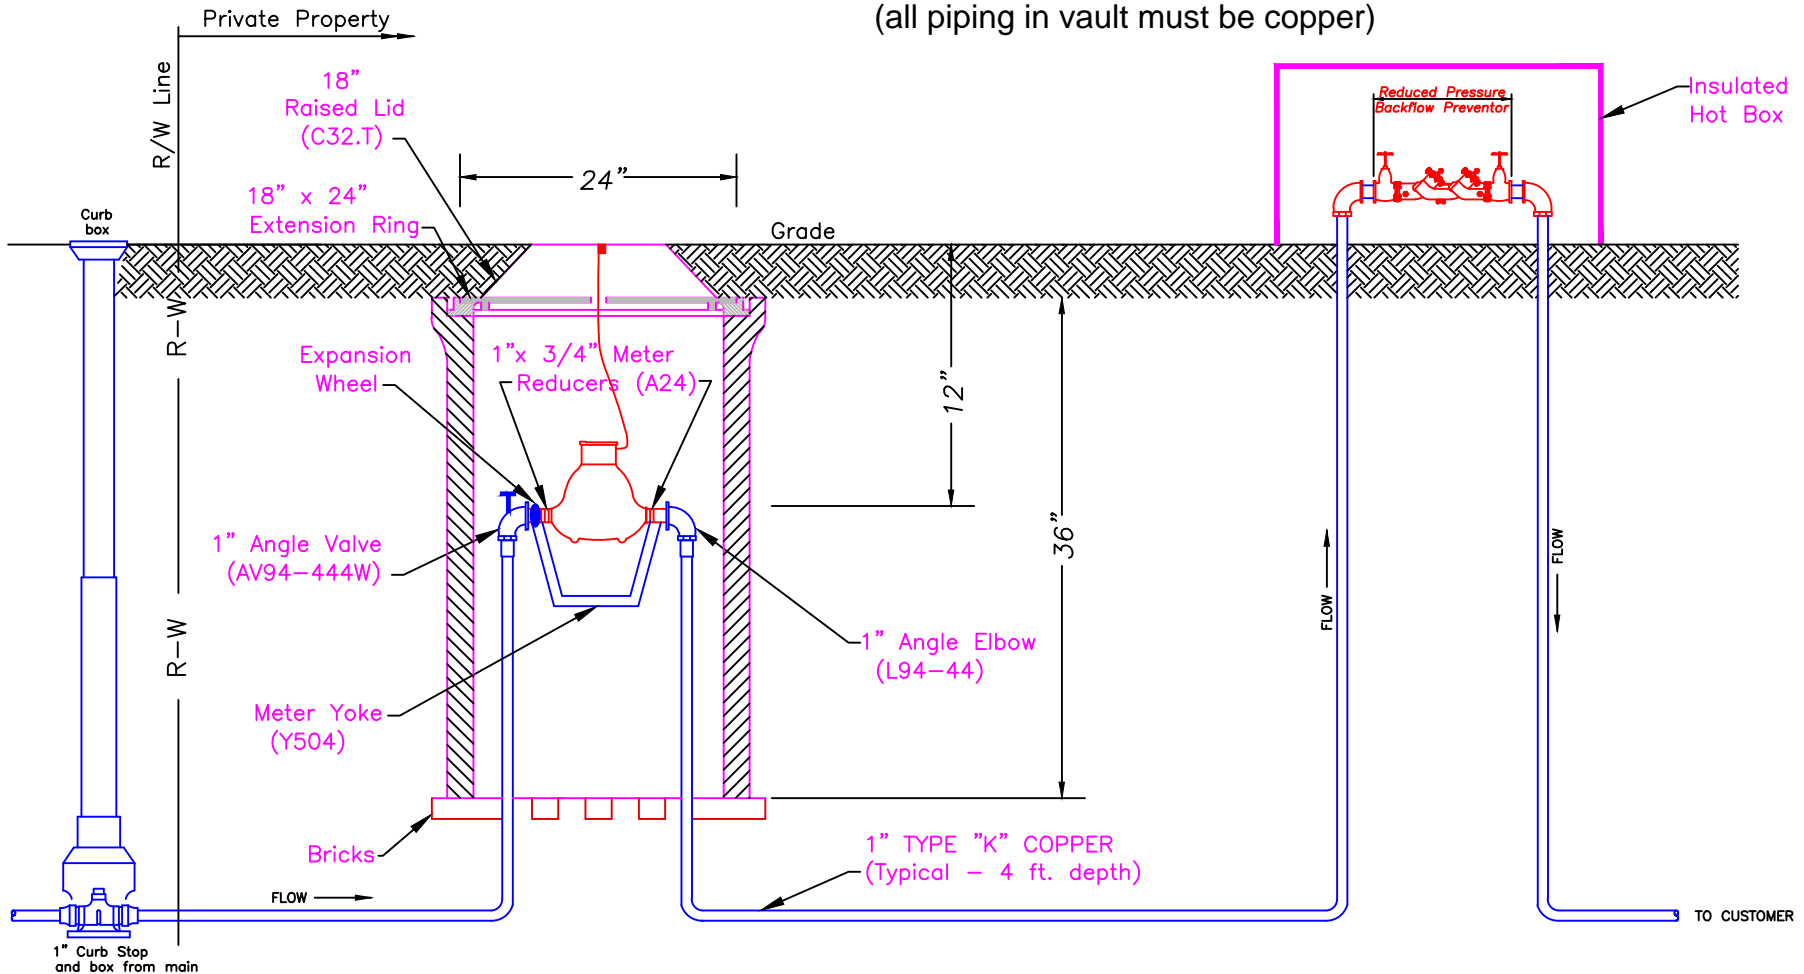

AQUA OHIO, INC.
 SERVICE CENTER, BOARDMAN, OH. 44512
 AN AFFILIATE OF AQUA AMERICA, INC.

SUBJECT

**OUTSIDE METER SETTING FOR
 5/8" x 3/4" AND 1" METERS
 WITH BACKFLOW PREVENTION**

revised February, 2012

division CORPORATE STANDARDS

drawn D. Warrick

date January, 2011

approved

sheet