


TYPICAL AQUA OHIO, INC. OUTSIDE METER VAULT WITH 5/8" x 3/4" AND 1" METERS
(all piping in vault must be copper)

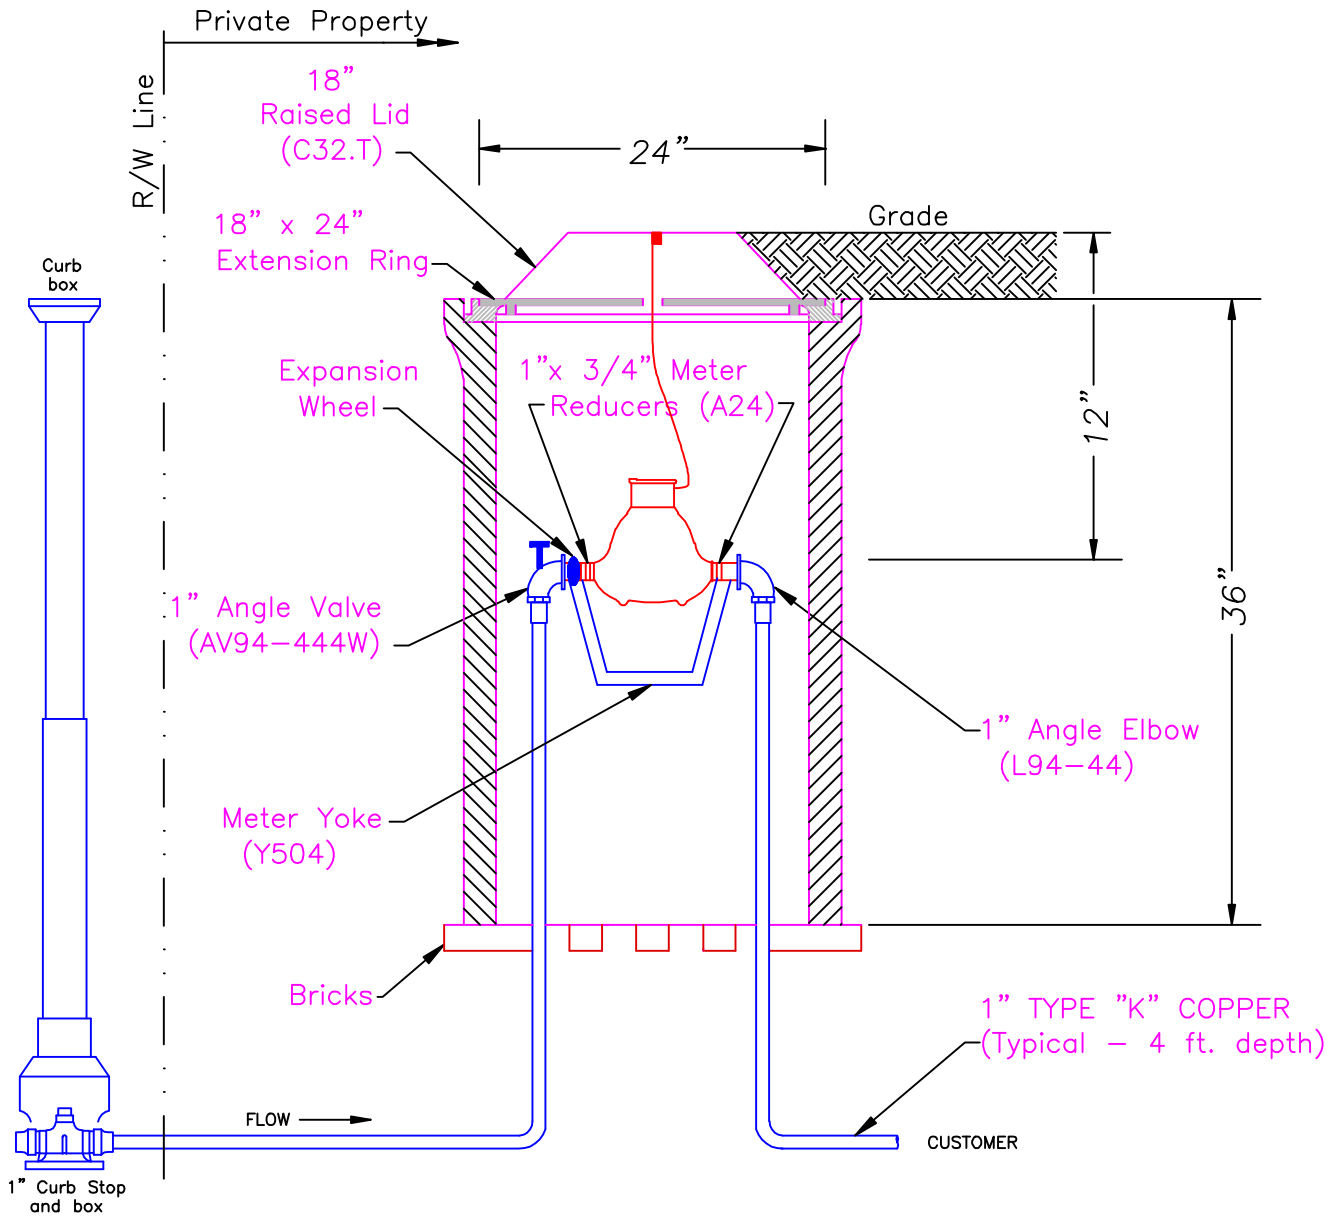

NOTES:

1. 24"(dia.) x 36" meter vaults may be constructed of corrugated plastic.
2. Contractor to remove and re-install meter at time of service renewal. Residents to be notified before shut off. (DO NOT CUT METER WIRE)

	<p>AQUA OHIO, INC. SERVICE CENTER, BOARDMAN, OH. 44512 AN AFFILIATE OF AQUA AMERICA, INC.</p>	<p>SUBJECT OUTSIDE METER SETTING FOR 5/8" x 3/4" AND 1" METERS WHERE BACKFLOW PREVENTION IS NOT NECESSARY</p>	
<p>revised <i>June., 2009</i></p>	<p>division <i>CORPORATE STANDARDS</i></p>		<p>sheet</p>
<p>drawn <i>D. Warrick</i></p>	<p>date <i>Jan., 2005</i></p>	<p>approved <i>R. Byrom, P.E.</i></p>	